


MIX2 secure series actuators RMG 4 U / RME 4 U

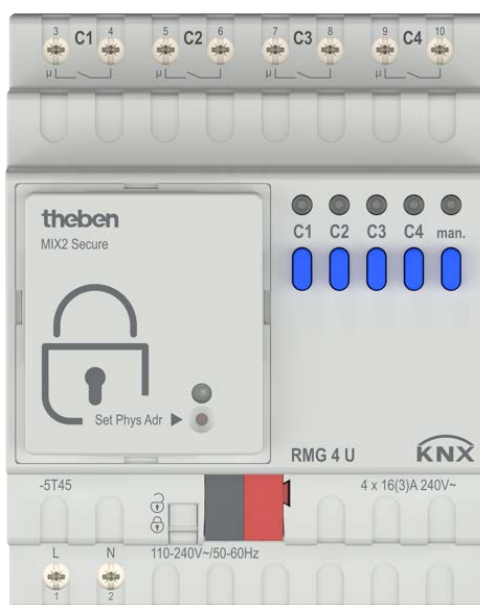

RMG 4 U	4930223
RME 4 U	4930228

Contents

1	Functional characteristics	4
2	MIX2 secure	5
2.1	BCU and application programmes	5
3	MIX and MIX2 devices	6
3.1	Operation	6
4	Technical data	7
5	General information about KNX Secure	8
5.1	Start-up with "KNX Data Secure"	8
5.2	Start-up without "KNX Data Secure"	9
6	The application programme "MIX2 secure"	10
6.1	Selection in the product database	10
6.2	Communication objects	11
6.2.1	Channel-related objects:	11
6.2.2	Common objects:	12
6.2.3	Description of objects	13
6.3	Parameter	19
6.3.1	Parameter pages	19
6.3.2	Parameter description	20
6.3.2.1	The "General" parameter page	20
6.3.2.2	The "RMG 4 U basic module" parameter page	22
6.3.2.3	The "RMG 4 U channel Cx: Configuration options" parameter page	23
6.3.2.4	The "Contact characteristics" parameter page	25
6.3.2.5	The "On/Off delay" parameter page	26
6.3.2.6	The "Pulse function.." parameter page	26
6.3.2.7	The "Staircase light with forewarning function .." parameter page	27
6.3.2.8	The "Flashing.." parameter page	28
6.3.2.9	The "Threshold" parameter page	29
6.3.2.10	The "Block function" parameter page	31
6.3.2.11	The "Scenes" parameter page	32
6.3.2.12	The "Feedback" parameter page	35
6.3.2.13	The "Hour counter and service" parameter page	36
6.3.2.14	The "Link" parameter page	37
7	Typical applications	38
7.1	2x switching with push button interface	38
7.1.1	Devices:	38
7.1.2	Overview	38
7.1.3	Objects and links	38
7.1.4	Important parameter settings	39
7.2	Switching light with service counter and display	40
7.2.1	Devices	40

7.2.2	Overview	40
7.2.3	Objects and links	41
7.2.4	Important parameter settings	42
7.3	Simple warning function with flashing light.....	43
7.3.1	Devices:	43
7.3.2	Overview	43
7.3.3	Objects and links	43
7.3.4	Important parameter settings	44
8	Appendix	45
8.1	The scenes.....	45
8.1.1	Principle	45
8.1.2	Call up or save scenes:	46
8.1.3	Teach in scenes without telegrams (MIX2 and FIX devices ONLY)	48
8.2	Conversion of percentages to hexadecimal and decimal values.....	48

1 Functional characteristics

- MIX2 4-way switch actuator.
- MIX2 basic module.
- Can be upgraded to a maximum of 12 channels.
- Up to 2 MIX or MIX2 extension modules can be connected to a basic module.*
- Device and KNX bus module can be swapped independently of each other.
- Removable KNX bus module enables devices to be changed without reprogramming.*
- Manual set-up and use of switch actuators is also possible without KNX bus module.*
- LED switching status indicator for each channel.
- Manual operation on device (even without bus voltage).
- Adjustable features: e.g. switching, delayed switching, pulse function.
- Links, type of contact (NC contact/NO contact) and participation in central commands such as permanent On, permanent Off, central switching, and save/call up scene.
- Switch functions: e.g. On/Off, pulse, On/Off delay, staircase light with forewarning.
- Logical links: e.g. block, AND, release, OR.
- Activation of the channel function via 1-bit telegram or 8-bit threshold.



This manual can only be used for devices with MIX2 secure BCU.

* MIX2 devices only.





2 MIX2 secure

i Each MIX2 basic module can be used with both a standard and a secure BCU.

i The extension units (MIX and MIX2) are always compatible.

2.1 BCU and application programmes

i For the MIX2 secure BCU, the application programme MIX2 secure V2.x is required.

	Standard	Secure
BCU		 <i>FDSK on the back</i>
MIX2 basic module with BCU		
Application programme	MIX2 V1.x	MIX2 secure V2.x

3 MIX and MIX2 devices

The MIX2 series consists of the basic modules RMG 8 S, RMG 8 T, RMG 4 I, RMG 4 U, DMG 2 T, JMG 4 T, JMG 4 T 24V, HMG 6 T, BMG 6 T + extensions RME 8 S, RME 8 T, RME 4 I, RME 4 U, DME 2 T, JME 4 T, JME 4 T 24V, HMG 6 T, BME 6 T (2021).

Any MiX and MIX2 extension modules can be connected to a MIX2 basic module.

Table 1

Device type	Ord. No.	Designation	Can be used with basic module..	
			in the MIX series	in the MIX2 series
MIX2 basic modules	493...	RMG 8 S, RMG 8 T, RMG 4 I, RMG 4 U, DMG 2 T, JMG 4 T, JMG 4 T 24V, HMG 6 T, BMG 6 T	-	-
MIX2 extensions	493...	RME 8 S, RME 8 T, RME 4 I, RME 4 U, DME 2 T, JME 4 T, JME 4 T 24V, HME 6 T, BME 6 T	no	Yes
MIX basic modules	491...	BMG 6, DMG 2 S, HMG 4, JMG 4 S, RMG 4 S, RMG 4 C-load, SMG 2 S	-	-
MIX extensions	491...	BME 6, DME 2 S, HME 4, JME 4 S, RME 4 S, RME 4 C-load, SME 2 S	yes	Yes*

* Adjusted parameter display and object numbering.

3.1 Operation

Each channel can be switched on and off independently of all parameters using the buttons on the device. A status LED displays the current switching status.

All bus telegrams are ignored with manual operation switched on (manual button) and the channels are exclusively to be operated via the buttons.

Mains voltage is required for the functioning of the buttons and LEDs, bus voltage or bus module are not required.

4 Technical data

KNX operating voltage

5 General information about KNX Secure

ETS Version 5.7 and higher support secure communication in KNX systems. A distinction is made between secure communication via the IP medium using KNX IP Secure and secure communication via the TP and RF media using KNX Data Secure. The following information refers to KNX Data Secure.



In the ETS catalogue, KNX products supporting "KNX Secure" are clearly identified:

As soon as a "KNX-Secure" device is included in the project, the ETS requests a project password. If no password is entered, the device is included with Secure Mode deactivated. However, the password can also be entered or changed later in the project overview.

5.1 Start-up with "KNX Data Secure"

For secure communication, the FDSK (Factory Device Setup Key) is required. If a KNX product supporting "KNX Data Secure" is included in a line, the ETS requires the input of the FDSK. This device-specific key is printed on the device label and can either be entered by keyboard or read by using a code scanner or notebook camera.

Example of FDSK on device label:



After entering the FDSK, the ETS generates a device-specific tool key. The ETS sends the tool key to the device to be configured via the bus. The transmission is encrypted and authenticated with the original and previously entered FDSK key. Neither the tool key nor the FDSK key are sent in plain text via the bus.

After the previous action, the device only accepts the tool key for further communication with the ETS.

The FDSK key is no longer used for further communication, unless the device is reset to the factory setting: In this case, all set safety-related data will be deleted.

The ETS generates as many runtime keys as needed for the group communication you want to protect. The ETS sends the runtime keys to the device to be configured via the bus. Transmission takes place by encrypting and authenticating them via the tool key. The runtime keys are never sent in plain text via the bus.

The FDSK is saved in the project and can be viewed in the project overview. All keys for this project can also be exported (backup).

During project planning, it can be defined subsequently which functions / objects are to communicate securely. All objects with encrypted communication are identified by the "Secure" icon in the ETS:



5.2 Start-up without "KNX Data Secure"

Alternatively, the device can also be put into operation without KNX Data Secure. In this case, the device is unsecured and behaves like any other KNX device without KNX Data Secure function. To start up the device without KNX Data Secure, select the device in the 'Topology' or 'Devices' section and set the 'Secure start up' option in the 'Properties' area of the 'Settings' tab to 'Disabled'.

6 The application programme "MIX2 secure"

6.1 Selection in the product database

Manufacturer	Theben AG
Product family	Output
Product type	RMG 4 U
Program name	MIX2 secure

The ETS database can be found on our downloads page: www.theben.de/en/downloads_en.

Table 2

Number of communication objects:	254
Number of group addresses:	254
Number of associations:	255

6.2 Communication objects

The objects are divided into channel-related and common objects

6.2.1 Channel-related objects:

Table 3:

No.	Object name	Function	Type DPT
1	RMG 4 U channel C1	Switch object	1 bit 1,001
		Threshold as percent	1 byte 5,001
		Threshold 0..255	1 byte 5,010
		Threshold EIS 5 (DPT9.xxx)	2 byte 9.xxx
		Threshold 0..65535	2 byte 7,001
2	RMG 4 U channel C1	Logic input in AND gate	1 bit 1,001
		Logic input in OR gate	1 bit 1,001
		Logic input in XOR gate	1 bit 1,001
3	RMG 4 U channel C1	Block	1 bit 1,003
4	RMG 4 U channel C1	Call up/save scenes	1 byte 18,001
5	RMG 4 U channel C1	Block scenes = 1	1 bit
		Enable scenes = 1	1,003
6	RMG 4 U channel C1	Feedback On/Off	1 bit 1,001
7	RMG 4 U channel C1	Time to next service	2 byte 7,001
		Operating hours feedback	2 byte 7,001
8	RMG 4 U channel C1	Service required	1 bit 1,001
9	RMG 4 U channel C1	Switching with priority	2 bit 2,001
		Reset service	1 bit 1,001
		Reset operating hours	1 bit 1,001
10	Not used		

6.2.2 Common objects:

These objects are partly used by the basic module and the two extension modules.

Table 4:

No.	Object name	Function	Type DPT
79	<i>RMG 4 U</i>	<i>Manual</i>	1 bit 1,001
159	<i>EM1 RME 4 U</i>		
239	<i>EM2 RME 4 U</i>		
241	<i>Central continuous ON</i>	<i>RMG/E4x/8x,DMG/E2x, SME2S</i>	1 bit 1,001
242	<i>Central continuous OFF</i>	<i>RMG/E4x/8x,DMG/E2x, SME2S</i>	1 bit 1,001
243	<i>Central switching</i>	<i>RMG/E4x/8x,DMG/E2x, SME2S</i>	1 bit 1,001
244	<i>Call up/save central scenes</i>	<i>RMG4x/8x,DMG/E2x, JMG/E4x,SME2S</i>	1 byte 18,001
245	<i>Central safety 1</i>	<i>For JME 4 S</i>	1 bit 1,001
246	<i>Central safety 2</i>	<i>For JME 4 S</i>	1 bit 1,001
247	<i>Central safety 3</i>	<i>For JME 4 S</i>	1 bit 1,001
248	<i>Central up/down</i>	<i>For JME 4 S</i>	1 bit 1,008
249	<i>Central safety rain</i>	<i>For JMG 4 T</i>	1 bit 1,002
250	<i>Central safety frost</i>	<i>For JMG 4 T</i>	1 bit 1,002
251	<i>Version of bus coupling unit</i>	<i>transmit</i>	14 byte 16,001
252	<i>Version of basic module</i>	<i>transmit</i>	14 byte 16,001
253	<i>Version of 1st extension module</i>	<i>transmit</i>	14 byte 16,001
254	<i>Version of 2nd extension module</i>	<i>transmit</i>	14 byte 16,001

6.2.3 Description of objects

- **Object 1** "Switch object, threshold as percent, threshold 0..255, threshold EIS 5 (DPT 9.xxx), threshold 0..65535 "

This object activates the set channel function (see parameter: *Channel function*).

The set channel function can either be activated via 1-bit telegram or by exceeding a threshold (8- or 16-bit telegram).

Table 5:

Parameter		Activation of channel function via
<i>Activation of function via</i>	<i>Type of threshold object</i>	
Switch object		1-bit telegram
<i>Exceeding the threshold</i>	<i>Object type: Percent (DPT 5.001)</i>	Exceeding percentage value
	<i>Object type: Counter value 0..255 (DPT 5.010)</i>	Any value in given numerical range
	<i>Object type: Counter value 0..65535 (DPT 7.001)</i>	
	<i>Object type: EIS5 e.g. CO2, brightness (DPT 9.xxx)</i>	2 byte floating-point number

- **Object 2** "Logic input in AND gate, in OR gate, in XOR gate"

Only available if *Link* is activated (*Configuration options* parameter page).
Forms a logical link together with object 1 to activate the channel function.

- **Object 3** "Block"

Locks the channel function.

Responses to setting and cancelling the block can be configured if the block function has been activated (*Configuration options* parameter page).

- **Object 4 "Call up/save scene"**

Only available if the scene function has been activated (*Configuration options* parameter page).

This object can be used to save and subsequently call up scenes.

Saving stores the channel status.

It does not matter how this status is produced (whether via switch commands, central objects or the buttons on the device).

The saved status is restored when it is called up.

All scene numbers from 1 to 64 are supported.

Each channel can participate in up to 8 scenes.

See appendix: Scenes

- **Object 5 "Block scenes = 1, Enable scenes = 1"**

Locks the scene function with a 1 or a 0 depending on the configuration.

As long as it is blocked, scenes cannot be saved or called up.

- **Object 6 "On/Off feedback"**

Reports the current channel status.

The status can also be fed back inverted depending on configuration.

- **Object 7 "Time to next service, operating hours feedback "**

Only available if the hour counter function

has been activated (*Configuration options* parameter page).

Reports, depending on selected *Type of hour counter* (*Hour counter and service* parameter page), either the remaining period to the next service or the current status of the hour counter.

- **Object 8 "Service required"**

Only available if the hour counter function has been activated (*Configuration options* parameter page) and *Type of hour counter* = *Counter for time to next service*.

Reports if the next service is due.

0 = not due

1 = service is due.

- **Object 9** "*Switching with priority, reset service, reset operating hours*"

The function of the object depends on whether or not the hour counter function has been activated (*Configuration options* parameter page).

<i>Activate hour counter</i>	Function	Use									
<i>yes</i>	<i>Reset service*</i>	Reset service interval counter.									
	<i>Reset operating hours*</i>	Reset hour counter									
<i>no</i>	<i>Switching with priority</i>	Priority control:									
		<table><tr><th>Status of object 9</th><th>Channel status</th></tr><tr><td>0</td><td rowspan="2">as set by object 1</td></tr><tr><td>1</td></tr><tr><td>2</td><td>OFF</td></tr><tr><td>3</td><td>ON</td></tr></table>	Status of object 9	Channel status	0	as set by object 1	1	2	OFF	3	ON
		Status of object 9	Channel status								
		0	as set by object 1								
		1									
		2	OFF								
3	ON										

* Depending on configuration.

- **Objects 79, 159, 239** "*Manual*"

Only available for devices in the MIX2 series (order number 493...)

Puts the relevant module in manual mode or sends the status of the manual operation.

Telegram	Meaning	Explanation
0	Auto	All channels can be operated via the bus as well as via the buttons.
1	Manual	The channels can only be operated via the buttons on the device. Bus telegrams will not work.

The duration of the manual mode, i.e. the *Function of the manual button* can be configured on the *General* parameter page.

- **Object 241** "*Central permanent ON*"

Central switch-on function.

Enables simultaneous switch on of all channels (basic and extension modules) with a single telegram.

0 = No function

1 = Permanent ON

Participation in this object can be set individually for each channel (*Configuration options* parameter page).

IMPORTANT:

This object takes top priority.

As long as it is set, the other switch commands will not work on the participating channels.

Works on the following devices:

RMG 4 U / RME 4 U, RMG 4 I / RME 4 I, RMG 8 S / RME 8 S, RMG 8 T / RME 8 T, RME 4 S / C-load, DMG 2 T, DME 2 S/T, SME 2 S.

- **Object 242** "*Central permanent OFF*"

Central switch-off function.

Enables simultaneous switch off of all channels (basic and extension modules) with a single telegram.

0 = No function

1 = Permanent OFF

Participation in this object can be set individually for each channel (*Configuration options* parameter page).

IMPORTANT: This object has the second highest priority after *Central permanent ON*. As long as it is set, the other switch commands will not work on the participating channels.

Works on the following devices:

RMG 4 U / RME 4 U, RMG 4 I / RME 4 I, RMG 8 S / RME 8 S, RMG 8 T / RME 8 T,
RME 4 S / C-load, DMG 2 T, DME 2 S/T, SME 2 S.

- **Object 243** "*Central switching*"

Central switch function.

Enables simultaneous switch on or off of all channels (basic and extension modules) with a single telegram.

0 = OFF

1 = ON

Participation in this object can be set individually for each channel (*Configuration options* parameter page).

With this object, every participating channel responds exactly as if its 1st object (i.e. obj. 1, 11, 21, etc.) were receiving a switch command.

Works on the following devices:

RMG 4 U / RME 4 U, RMG 4 I / RME 4 I, RMG 8 S / RME 8 S, RMG 8 T / RME 8 T,
RME 4 S / C-load, DMG 2 T, DME 2 S/T, SME 2 S.

- **Object 244** "*Call up/save central scenes*"

Central object for using scenes.

This object can be used to save and subsequently call up "scenes".

Works on the following devices:

RMG 4 I / RME 4 I, RMG 4 U / RME 4 U, RMG 8 S / RME 8 S, RMG 8 T / RME 8 T, DMG 2 T /
DME 2 T, JMG 4 T / JME 4 T, RME 4 S / C-load, DME 2 S, SME 2 S, JME 4 S

See appendix: Scenes

- **Objects 245 - 250**

Not used.

- **Object 251** "*Version of bus coupling unit*"

For diagnostic purposes only.

Sends the bus coupling unit software version after reset or download.
Can also be read out via the ETS.

Format: **Axx Hyy Vzzz**

Code	Meaning
xx	00 .. FF = Version of application without dividing point (17 = V1.7, 18 = V1.8 etc).
yy	Hardware version 00..99
zzz	Firmware version 000..999

EXAMPLE: A18 H25 V025

- ETS application version 1.8
- Hardware version \$25
- Firmware version \$25

- **Object 252** "*Version of basic module*"

For diagnostic purposes only.

Only for basic modules in the MIX2 series (order number 493...).

Sends the software version (firmware) of the basic module after reset or download.
Can also be read out via the ETS.

The version is issued as an ASCII character string.

Format: **Mxx Hyy Vzzz**

Code	Meaning
xx	01 .. FF = Module code (hexadecimal).
yy	Hardware version 00..99
zzz	Firmware version 000..999

EXAMPLE: M18 H25 V025

- Module \$18 = RMG 4 U
- Hardware version V25
- Firmware version V25

Possible module codes

Module	Code
Module or mains voltage are unavailable.	\$00
RMG 8 S	\$11
RMG 4 I	\$12
DMG 2 T	\$13
JMG 4 T/JMG 4 T 24V	\$14
HMG 6 T	\$15
RMG 8 T	\$17
RMG 4 U	\$18
BMG 6 T	\$92

- **Object 253** "*Version of 1st extension module*"

Telegram format: See above, object 252

Possible module codes

Module	Code
Module or mains voltage are unavailable.	\$00
RME 8 S	\$11
RME 4 I	\$12
DME 2 T	\$13
JME 4 T/JME 4 T 24V	\$14
HME 6 T	\$15
RME 8 T	\$17
RME 4 U	\$18
BME 6 T	\$92

- **Object 254** "*Version of 2nd extension module*"

See above, object 253

6.3 Parameter

6.3.1 Parameter pages

Table 6

Function	Description
General	Selection of modules and central parameters.
BASIC MODULE: RMG 4 U	General parameters for the basic module: Collective feedback and relay switch delay.
RMG 4 U channel Cx configuration options	Characteristics of channel and activation of additional functions (scenes, links, etc.).
Contact characteristics	Type of contact and status after download, bus failure etc.
Threshold	Settings for triggering channel function through exceeding threshold.
Block function	Type of block telegram and response to blocking.
Scenarios	Selection of scene numbers relevant to the channel.
Feedback	Status of feedback object etc.
Hour counter and service	Type of hour counter and, if required, service interval etc.
Link	Selection of logical link.

6.3.2 Parameter description

Settings that lead to the display of other pages or functions are identified by .. .

Example: *Pulse function..*

6.3.2.1 The "General" parameter page

Designation	Values	Description
Type of basic module	Select device.. RMG 8 S.. RMG 8 T.. RMG 4 I.. RMG 4 U.. DMG 2 T.. JMG 4 T/JMG 4 T 24V.. HMG 6 T..	Selection of available basic module (MIX2 series only)
Type of 1st extension module	not available/inactive RME 8 S.. RME 8 T.. RME 4 I.. RME 4 U.. DME 2 T.. JME 4 T/JME 4 T 24V.. HME 6 T.. RME 4 S/RME 4 C-load.. DME 2/SME 2.. BME 6.. JME 4 S.. HME 4..	Selection of 1st extension module, if available. (MIX or MIX2 series)
Type of 2nd extension module	not available/inactive RME 8 S.. RME 8 T.. RME 4 I.. RME 4 U.. DME 2 T.. JME 4 T/JME 4 T 24V.. HME 6 T.. RME 4 S/RME 4 C-load.. DME 2/SME 2.. BME 6.. JME 4 S.. HME 4..	Selection of 2nd extension module, if available. (MIX or MIX2 series)
Time for cycl. sending of feedback obj. (MIX series, order no. 491...)	2 minutes, 3 minutes, 5 minutes, 10 minutes, 15 minutes , 20 minutes 30 minutes, 45 minutes 60 minutes	This parameter is used exclusively for MIX series extension modules. (DME 2 S, SME 2, JME 4 S, BME 6 RME 4 S/C-load, and HME 4)
Function of manual button (MIX2 series, order no. 493...)	<i>applies for 24 hours or until reset via object blocked</i> applies until reset via object <i>applies for 30 minutes or until reset via object</i>	Determines how long the device works manually and how this is ended. In manual mode, the channels can only be switched on and off via the buttons on the device.

Designation	Values	Description
	<i>applies for 1 hour or until reset via object</i> <i>applies for 2 hours or until reset via object</i> <i>applies for 4 hours or until reset via object</i> <i>applies for 8 hours or until reset via object</i> <i>applies for 12 hours or until reset via object</i>	See also: object 79 This parameter is used exclusively for MIX2 series devices.
<i>Manual operation of channels (MIX2 series, order no. 493...)</i>	<i>unblocked</i> <i>blocked</i>	The channels can be operated via the buttons on the device. No manual operation, the buttons on the device are blocked..

6.3.2.2 The "RMG 4 U basic module" parameter page

Table 7

Designation	Values	Description
<i>Relay switch delay</i>		<p>This parameter sets the minimum delay between switching on 2 relays if several are activated at the same time. The shortest delay is achieved by using the central switch object (object 243).</p> <p>When switching on via individual telegrams (1 telegram per channel), the bus running times and the sequential processing of commands cause an additional delay.</p> <p>This can help avoid high current peaks when devices are switched on simultaneously (e.g. with a number of lighting strips).</p> <p>None There is no added delay.</p> <p>60 ms 100 ms 200 ms When a relay switches on, the next one can only switch on after the set delay is completed. The switch-on delay between the first and last relay is calculated according to the following formula: (Number of channels – 1) x delay Example: RMG 4 U and 60 ms: = (4 channels – 1) * 60 ms = 180 ms Channel C4 switches 180 ms after C1.</p>

6.3.2.3 The "RMG 4 U channel Cx: Configuration options" parameter page

Table 8

Designation	Values	Description
<i>Channel function</i>	Switching On/Off.. <i>On/off time delay..</i> <i>Pulse function..</i> <i>Staircase light timer switch with forewarning function..</i> <i>Flashing..</i>	Determines the basic functionality of the channel.
<i>Activation of function via</i>	Switch object <i>Exceeding the threshold</i>	The channel is operated via a 1-bit object. The channel is operated through exceeding a 1 or 2-byte threshold. See below: The „Threshold“ parameter page
<i>Adjust block function</i>	<i>Yes..</i> no	The block function can be individually adjusted. The relevant parameter page is shown. The block function works with the standard parameters: - <i>Block with ON telegram</i> - <i>When setting the block: Unchanged</i> - <i>When cancelling: Update.</i>
<i>Activate scenes</i>	<i>Yes..</i> no	Should scenes be used?
<i>Participation in central objects</i>	no <i>at Central switching, Permanent On, Permanent OFF only in central continuous ON only in central continuous OFF only in central switching only in central switching and continuous ON only in central switching and continuous OFF only in central permanent On and permanent OFF</i>	Central objects are not taken into account. Which central objects are to be taken into account? Central objects enable the simultaneous switching on and off of several channels with one single object.
<i>Adjust feedback</i>	<i>Yes..</i> no	The feedback function can be individually adjusted. The relevant parameter page is shown. The <i>Feedback</i> function works with the standard parameters: - <i>not inverted</i> - <i>do not transmit cyclically</i>
<i>Activate hour counter</i>	<i>Yes..</i> no	Is the <i>hour counter/service interval</i> function to be used?

Designation	Values	Description
<i>Activate link</i>	<i>Yes..</i> <i>no</i>	Are logical links to be used with the channel object?

6.3.2.4 The "Contact characteristics" parameter page

Table 9

Designation	Values	Description
<i>Type of contact</i>	<i>NO contact</i> <i>NC contact</i>	Standard: The relay contact is closed when a switch-on command is issued. Inverted: The relay contact is opened when a switch-on command is issued.
<i>Status with download and bus failure</i>	<i>OFF</i> <i>ON</i> <i>unchanged</i>	After download or with loss of bus voltage... ..the relay remains switched off. ..the relay switches on. ...the relay remains in the same state as before.
<i>Status after restoration of the mains supply or bus supply</i>	<i>OFF</i> <i>ON</i> <i>Same as before failure</i>	After return of mains or bus voltage... ..the relay remains switched off. ..the relay switches on. ...the relay remains in the same state as before.

6.3.2.5 The "On/Off delay" parameter page

This parameter page appears if *On/Off delay* is chosen as the *Channel function*.

Table 10

Designation	Values	Description
<i>Switch-on delay</i>		
<i>hours (0..3)</i>	0..3	Input of desired switch-on delay in hours.
<i>minutes (0..60)</i>	0..60	Input of desired switch-on delay in minutes.
<i>seconds (0.225)</i>	0..255	Input of desired switch-on delay in seconds.
<i>Switch-off delay</i>		
<i>hours (0..3)</i>	0..3	Input of desired switch-off delay in hours.
<i>minutes (0..60)</i>	0..60	Input of desired switch-off delay in minutes.
<i>seconds (0.255)</i>	0..255	Input of desired switch-off delay in seconds.

6.3.2.6 The "Pulse function.." parameter page

This parameter page appears if *Pulse function* is chosen as the *Channel function*.

Table 11

Designation	Values	Description
<i>hours (0..3)</i>	0..3	Input of desired pulse duration in hours.
<i>minutes (0..60)</i>	0..60	Input of desired pulse duration in minutes.
<i>seconds (0.255)</i>	0..255	Input of desired pulse duration in seconds.
<i>Pulse can be retriggered (with 1 on switch object)</i>	yes	The pulse can be extended as often as desired via a 1-telegram
	no	The pulse cannot be extended.
<i>Pulse can be reset (with 1 on switch object)</i>	yes	The pulse can be ended early at anytime via a 0-telegram.
	no	The pulse cannot be ended early

6.3.2.7 The "Staircase light with forewarning function .." parameter page

This parameter page appears if *Staircase light with forewarning function* is chosen as the *Channel function*.

The user can, anytime, press a push button again, to extend the staircase light time.

Table 12

Designation	Values	Description
Staircase light time (min. 1 s)		
hours (0..3)	0..3	Input of desired staircase light time in hours.
minutes (0..60)	0..60	Input of desired staircase light time in minutes.
seconds (0.255)	0..255 Default value = 1	Input of desired staircase light time in seconds.
The maximum sum of pulses 1..40	1..40	determines how often the staircase light time can be extended (restarted) by pressing the button again.
Duration of 1st forewarning in s (0..60)	0 1..60 Default value = 10	The light switches off immediately once the staircase light time is completed. Once the staircase light time is completed, the light should briefly flash and then stay on for the duration of the forewarning
Duration of 2nd forewarning in s (0..60)	0 1..60 Default value = 10	No 2nd forewarning. The light switches off at the end of the 1st forewarning. Second forewarning: Once the 1st forewarning is completed, the light should flash briefly and then stay on for the duration of the 2nd forewarning. The light switches off when this time is completed.

Example of forewarning function:

Staircase light time	Flashing	1st forewarning	Flashing	2nd forewarning	OFF
----------------------	----------	-----------------	----------	-----------------	-----

6.3.2.8 The "Flashing.." parameter page

This parameter page appears if *Flashing* is chosen as the *Channel function*.

Table 13

Designation	Values	Description
<i>ON phase of flash pulse</i>		
<i>hours (0..3)</i>	0..3	Input of desired pulse time (t _i) in hours.
<i>minutes (0..60)</i>	0..60	Input of desired pulse time in minutes.
<i>seconds (0.255)</i>	0..255	Input of desired pulse time in seconds.
<i>OFF phase of flash pulse</i>		
<i>hours (0..3)</i>	0..3	Input of desired length of break (t _p) in hours.
<i>minutes (0..60)</i>	0..60	Input of desired length of break in minutes.
<i>seconds (0.255)</i>	0..255	Input of desired length of break in seconds.
<i>How often should it flash</i>	<i>Until it switches off</i> 1 x 2 x 3 x 4 x 5 x 7 x 10 x 15 x 20 x 30 x 50 x	The channel flashes until a switch-off telegram is received. The channel flashes as often as set here.

6.3.2.9 The "Threshold" parameter page

This page is shown if the *Activation of the function by parameter* is set to *Exceeding threshold*.

Table 14

Designation	Values	Description
<i>Type of threshold object</i>	Object type: Percent (DPT 5.001) <i>Object type: Counter value 0..255 (DPT 5.010)</i> <i>Object type: Counter value 0..65535 (DPT 7.001)</i> <i>Object type: EIS5 e.g. CO2, brightness etc. (DPT 9.xxx)</i>	Value type for threshold.
<i>Response on exceeding the threshold</i>	<p><i>As switch object = 0</i></p> <p><i>As switch object = 1</i></p>	<p>Should the channel switch on or off on exceeding the threshold? The set <i>type of contact</i> must be taken into account here.</p> <p><i>NO contact:</i> The relay switches off if threshold is exceeded. <i>NC contact:</i> The relay switches on if threshold is exceeded.</p> <p><i>NO contact:</i> The relay switches on if threshold is exceeded. <i>NC contact:</i> the relay switches off if threshold is exceeded.</p>
Parameter for <i>Percent</i> threshold object		
<i>Threshold</i>	1..99 % Default value = 50%	Desired threshold. Example of <i>NO contact</i> with response <i>as switch object = 1</i> : Switches on when: Object value > threshold Switches off when: Object value < threshold - hysteresis
<i>Hysteresis (as %)</i>	1..99 % Default value = 10%	The hysteresis prevents frequent change overs after small fluctuations in readings.
Parameter for threshold object <i>Counter value 0..255</i>		
<i>Lower threshold</i>	1..254 Default value = 127	Desired threshold. Example of <i>NO contact</i> with response <i>as switch object = 1</i> : Switches on when: Object value > threshold Switches off when: Object value < threshold - hysteresis
<i>Hysteresis</i>	1..254 Default value = 5	The hysteresis prevents frequent change overs after small fluctuations in readings.
Parameter for threshold object <i>Counter value 0..65535</i>		
<i>Lower threshold</i>	1..65534	Desired threshold.

Designation	Values	Description
	<i>Default value = 1000</i>	Example of <i>NO contact</i> with response as switch object = 1: Switches on when: Object value > threshold Switches off when: Object value < threshold - hysteresis
<i>Hysteresis</i>	<i>1..65534</i> <i>Default value = 5</i>	The hysteresis prevents frequent change overs after small fluctuations in readings.
Parameter for threshold object EIS5 (e.g. CO₂, brightness...)		
<i>Lower threshold</i> <i>Format (-)0.00..99999</i>	<i>0.00..99999</i> <i>Default value = 20</i>	Desired threshold. Example of <i>NO contact</i> with response as switch object = 1: Switches on when: Object value > threshold Switches off when: Object value < threshold - hysteresis
<i>Hysteresis</i> <i>0.00..9999</i>	<i>0.00..9999</i> <i>Default value = 1</i>	The hysteresis prevents frequent change overs after small fluctuations in readings.

6.3.2.10 The "*Block function*" parameter page

This page appears when *Adjust block function* is selected on the *Configuration options* parameter page.

Table 15

Designation	Values	Description
<i>Block telegram</i>	<i>Block with ON telegram</i>	0 = Enable 1 = Block
	<i>Block with OFF telegram</i>	0 = Block 1 = Enable Note: The block is always deactivated after reset.
<i>Response when setting the block</i>	<i>OFF</i>	Switch off
	<i>ON</i>	Switch on
	<i>unchanged</i>	No response
<i>Response when cancelling the block</i>	<i>OFF</i>	Switch off
	<i>ON</i>	Switch on
	<i>Unchanged</i>	No response
	<i>update</i>	Restore normal operation and switch relay accordingly.

6.3.2.11 The "Scenes" parameter page

This page appears when the *Scenes* are activated on the *Configuration options* parameter page.
Each channel can participate in up to 8 scenes.

Table 16

Designation	Values	Description
<i>Block telegram for scenes</i>	Block with ON telegram Block with OFF telegram	0 = Enable 1 = Block 0 = Block 1 = Enable Note: With this setting the scenes are always blocked immediately after reset or download.
<i>All channel scene statuses</i>	Overwrite on download Unchanged after download	A download deletes all scene memories in a channel, i.e. all previously taught in scenes. When a scene number is called, the channel assumes the configured <i>Status after download</i> (see below). See appendix: Teach in scenes without telegrams All previously taught in scenes are saved. However, the scene numbers the channel should react to can be changed (see below: <i>Channel reacts to</i>).
<i>Participation in central scene object</i>	No yes	Should the device react to the central scene object?
<i>Channel reacts to</i>	No scene number Scene number 1 Scene number 63	First of the 8 possible scene numbers the channel is to react to.
<i>Status after download</i>	Off On	New switching status that the selected scene number is to be allocated to. Only possible if the scene statuses are to be overwritten after download.
<i>Permit teach in</i>	No Yes	Scenes can only be called up. The user can both call up and teach in or amend scenes.
<i>Channel reacts to</i>	No scene number Scene number 1 Scene number 2 ... Scene number 63	Second of the 8 possible scene numbers
<i>Status after download</i>	Off On	See above.

Designation	Values	Description
<i>Permit teach in</i>	<i>No</i> <i>Yes</i>	See above.
<i>Channel reacts to</i>	<i>No scene number</i> <i>Scene number 1</i> ... <i>Scene number 3</i> ... <i>Scene number 63</i>	Third of the 8 possible scene numbers
<i>Status after download</i>	<i>Off</i> <i>On</i>	See above.
<i>Permit teach in</i>	<i>No</i> <i>Yes</i>	See above.
<i>Channel reacts to</i>	<i>No scene number</i> <i>Scene number 1</i> ... <i>Scene number 4</i> ... <i>Scene number 63</i>	Fourth of the 8 possible scene numbers
<i>Status after download</i>	<i>Off</i> <i>On</i>	See above.
<i>Permit teach in</i>	<i>No</i> <i>Yes</i>	See above.
<i>Channel reacts to</i>	<i>No scene number</i> <i>Scene number 1</i> ... <i>Scene number 5</i> ... <i>Scene number 63</i>	Fifth of the 8 possible scene numbers
<i>Status after download</i>	<i>Off</i> <i>On</i>	See above.
<i>Permit teach in</i>	<i>No</i> <i>Yes</i>	See above.
<i>Channel reacts to</i>	<i>No scene number</i> <i>Scene number 1</i> ... <i>Scene number 6</i> ... <i>Scene number 63</i>	Sixth of the 8 possible scene numbers
<i>Status after download</i>	<i>Off</i> <i>On</i>	See above.
<i>Permit teach in</i>	<i>No</i> <i>Yes</i>	See above.
<i>Channel reacts to</i>	<i>No scene number</i> <i>Scene number 1</i> ... <i>Scene number 7</i> ... <i>Scene number 63</i>	Seventh of the 8 possible scene numbers

Designation	Values	Description
<i>Status after download</i>	<i>Off</i> <i>On</i>	See above.
<i>Permit teach in</i>	<i>No</i> <i>Yes</i>	See above.
<i>Channel reacts to</i>	<i>No scene number</i> <i>Scene number 1</i> ... <i>Scene number 8</i> ... <i>Scene number 63</i>	Last of the 8 possible scene numbers
<i>Status after download</i>	<i>Off</i> <i>On</i>	See above.
<i>Permit teach in</i>	<i>No</i> <i>Yes</i>	See above.

6.3.2.12 The "*Feedback*" parameter page

This page appears when *Adjust feedback* is selected on the *Configuration options* parameter page.

Table 17

Designation	Values	Description
<i>Reported status</i>	<i>Not inverted</i>	Channel switched on: feedback object sends a 1
	<i>inverted</i>	Channel switched on: feedback object sends a 0
<i>Transmit feedback cyclically</i>	<i>No</i> <i>yes</i>	Send at regular intervals?
<i>Time for cyclical transmission of feedback</i>	<i>2 minutes, 3 minutes, 5 minutes, 10 minutes, 15 minutes, 20 minutes, 30 minutes, 45 minutes 60 minutes</i>	At what interval?

6.3.2.13 The "*Hour counter and service*" parameter page

This page appears when *Activate hour counter* is selected on the *Configuration options* parameter page.

Table 18

Designation	Values	Description
<i>Type of hour counter</i>	<i>Hour counter</i> <i>Counter for time period before next service</i>	Forward counter for duty cycle of the channel. Backward counter for duty cycle of the channel.
Hour counter		
<i>Reporting of operating hours when changing (0..100 h, 0 = no report)</i>	0..100 Default value = 10	At what interval is the current meter reading to be sent? Example: 10 = Send each time the meter reading increases by another 10 hours.
<i>Report operating hours cyclically</i>	No yes	Send at regular intervals?
<i>Time for cyclical transmission</i>	2 minutes, 3 minutes, 5 minutes, 10 minutes, 15 minutes, 20 minutes, 30 minutes, 45 minutes 60 minutes	At what interval?
Counter for time period before next service		
<i>Service interval (0..2000, x10 h)</i>	0..2000 Default value = 100	Desired timescale between 2 services. Example: 10 = 10 x 10 h = 100 hours
<i>Reporting of time to service when changing (0..100 h, 0 = no report)</i>	0..100 Default value = 10	At what interval is the current meter reading to be sent? Example: 10 = Send each time the meter reading decreases by another 10 hours.
<i>Report time to service cyclically</i>	no Yes	Send remaining time to next service at regular intervals? Object <i>Time to next service</i> .
<i>Report service cyclically</i>	no Yes	Send expiry of time to next service at regular intervals? Object <i>Service required</i> .
<i>Time for cyclical transmission (time to service and service)</i>	2 minutes, 3 minutes, 5 minutes, 10 minutes, 15 minutes, 20 minutes, 30 minutes, 45 minutes 60 minutes	At what interval?

6.3.2.14 The "*Link*" parameter page

This page appears when *Activate link* is selected on the *Configuration options* parameter page.

An additional object appears, which forms a logical link in combination with the channel's switching/threshold object.

The channel only switches if the link requirement has been met.

Table 19

Designation	Values	Description
<i>Activate link</i>	<i>AND link</i>	The <i>Logic input in AND gate</i> object appears (e.g. object 2).
	<i>OR link (override)</i>	The <i>Logic input in OR gate</i> object appears (e.g. object 2).
	<i>XOR link</i>	The <i>Logic input in XOR gate</i> object appears (e.g. object 2).
<i>Disable object affects logic object</i>	<i>No</i>	The disable object only affects the channel object (e.g. object 1). If required, the logic object can activate the channel function despite block (with OR and XOR link).
	<i>yes</i>	The disable object affects the channel object and the logic object. The channel function is completely blocked if the block is active.

7 Typical applications

These typical applications are designed to aid planning and are not to be considered an exhaustive list. It can be extended and updated as required.

7.1 2x switching with push button interface

2 push buttons are connected to a TA 2 push button interface and they control 2 channels of the RMG 4 U.

7.1.1 Devices:

- RMG 4 U (4930223)
- TA 2 S (4969222)

7.1.2 Overview

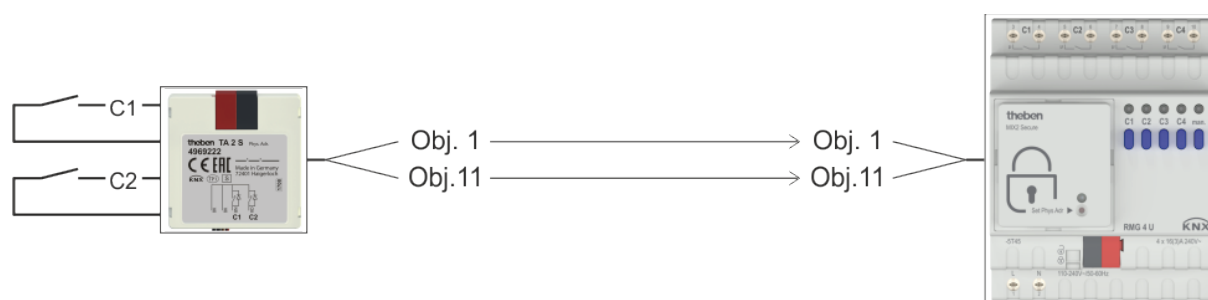


Figure 1

7.1.3 Objects and links

Table 20

No.	TA 2 S	No.	RMG 4 U	Comment
	Object name		Object name	
1	Channel 1 switching	1	RMG 4 U channel C1 Switch object	-
11	Channel 2 switching	11	RMG 4 U channel C2 switch object	-

7.1.4 Important parameter settings

Standard or customer-defined parameter settings apply for unlisted parameters.

Table 21: TA 2 S

Parameter page	Parameter	Setting
<i>Channel 1 / Configuration options</i>	<i>Channel function 1</i>	<i>Push button</i>
<i>Channel 2 / Configuration options</i>	<i>Channel function 2</i>	<i>Push button</i>

Table 22: RMG 4 U

Parameter page	Parameter	Setting
<i>RMG 4 U channel C1: Configuration options</i>	<i>Channel function</i>	<i>Switching ON/OFF</i>
	<i>Activation of function via</i>	<i>Switch object</i>
<i>Contact characteristics</i>	<i>Type of contact</i>	<i>NO contact</i>
<i>RMG 4 U channel C2</i>	<i>See channel C1</i>	

7.2 Switching light with service counter and display

A fluorescent light strip in a hall is controlled by channel C1.

The lamps have to be replaced after 20,000 hours (= service).

The time period to the service and the service status are shown on the VARIA 826 S display.

7.2.1 Devices

- RMG 4 U (4930223)
- VARIA 826 S (8269210/8269211)

7.2.2 Overview

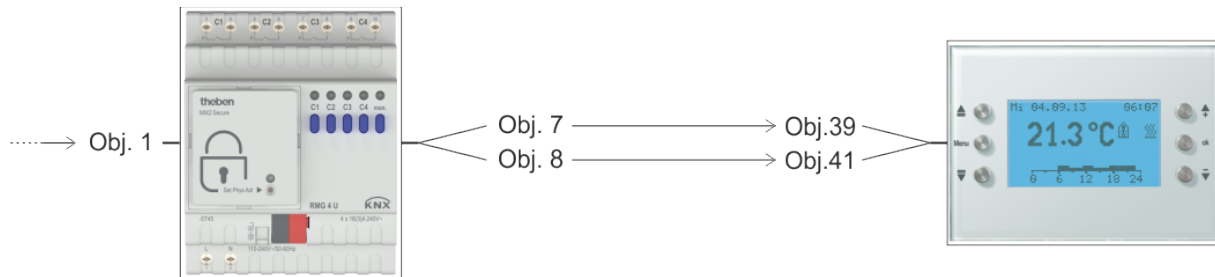


Figure 2

7.2.3 Objects and links

Table 23

No.	KNX sensor	No.	RMG 4 U	Comment
	Object name		Object name	
-	<i>(Switching object)</i>	1	<i>Switch object</i>	Any KNX sensor: Push button, time switch, twilight switch, etc. sends the switch command to RMG 4 U

Table 24:

No.	RMG 4 U	No.	VARIA	Comment
	Object name		Object name	
7	<i>Time to next service</i>	39	<i>Counter value 0 ..65535</i>	Time in hours
8	<i>Service required</i>	41	<i>Switching ON/OFF</i>	1 = Time has elapsed

7.2.4 Important parameter settings

Standard or customer-defined parameter settings apply for unlisted parameters.

Table 25: RMG 4 U

Parameter page	Parameter	Setting
<i>General</i>	<i>Type of basic module</i>	<i>RMG 4 U</i>
<i>RMG 4 U channel C1:</i>	<i>Channel function</i>	<i>Switching ON/OFF</i>
<i>Configuration options</i>	<i>Activate hour counter</i>	<i>Yes..</i>
<i>Contact characteristics</i>	<i>Type of contact</i>	<i>NO contact</i>
<i>Hour counter and service</i>	<i>Type of hour counter</i>	<i>Counter for time period before next service</i>
	<i>Service interval (0..2000, x10 h)</i>	<i>200</i>
	<i>Reporting of time to service when changing (0..100 h, 0 = no report)</i>	<i>100</i>
	<i>Report service cyclically</i>	<i>yes</i>

Table 26: VARIA

Parameter page	Parameter	Setting
<i>Selection of display pages</i>	<i>Show page 1 for display objects</i>	<i>yes</i>
<i>Display objects page 1</i>	<i>Fade in operating instructions on page 1</i>	<i>No</i>
	<i>Page heading</i>	<i>Lamp maintenance*</i>
<i>Page 1, line 1</i>	<i>Line format</i>	<i>16 bit counter value object type</i>
	<i>Text for line 1</i>	<i>Service in*</i>
	<i>Unit for display object</i>	<i>h</i>
	<i>Value range</i>	<i>Negative and positive numbers</i>
	<i>Display before receipt of value</i>	<i>Read from object via bus</i>
<i>Page 1, line 2</i>	<i>Line format</i>	<i>Switch on object type</i>
	<i>Text for line 1</i>	<i>Lamp status*</i>
	<i>Text for object value = 0</i>	<i>OK*</i>
	<i>Text for object value = 1</i>	<i>Service*</i>
	<i>Display before receipt of value</i>	<i>Read from object via bus</i>

*Suggested text

7.3 Simple warning function with flashing light

A monitoring device, e.g. flood alarm is connected to a TA 2 S push button interface, and it controls a channel of the RMG 4 U.

A lamp shall flash in the event of an error (channel 1 relay output).

7.3.1 Devices:

- RMG 4 U (4930223)
- TA 2 S (4969222)

7.3.2 Overview

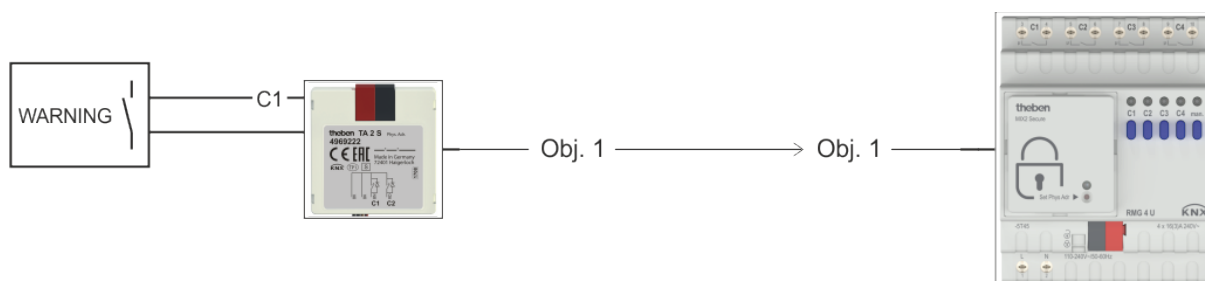


Figure 3

7.3.3 Objects and links

Table 27

No.	TA 2 S	No.	RMG 4 U	Comment
	Object name		Object name	
1	Channel 1 switching	1	RMG 4 U channel C1 Switch object	-

7.3.4 Important parameter settings

Standard or customer-defined parameter settings apply for unlisted parameters.

Table 28: TA 2 S

Parameter page	Parameter	Setting
<i>Channel 1 / Configuration options</i>	<i>Channel function</i>	<i>Switch</i>

Table 29: RMG 4 U

Parameter page	Parameter	Setting
<i>General</i>	<i>Type of basic module</i>	<i>RMG 4 U</i>
<i>RMG 4 U channel C1: Configuration options</i>	<i>Channel function</i>	<i>Flashing</i>
	<i>Activation of function via</i>	<i>Switch object</i>
<i>Contact characteristics</i>	<i>Type of contact</i>	<i>NO contact</i>
<i>Flashing</i>	<i>ON phase:</i>	
	<i>Hours</i>	<i>0</i>
	<i>Minutes</i>	<i>0</i>
	<i>Seconds</i>	<i>1</i>
	<i>OFF phase:</i>	
	<i>Hours</i>	<i>0</i>
	<i>Minutes</i>	<i>0</i>
	<i>Seconds</i>	<i>1</i>
	<i>How often should it flash</i>	<i>Until it switches off</i>

8 Appendix

8.1 The scenes

8.1.1 Principle

The current status of a channel, or a complete MIX system can be stored and retrieved as required at a later point via the scene function.

That applies to switching, blinds and dimming channels.
Each channel can participate simultaneously in up to 8 scenes.

This requires permission to access scenes for the relevant channel via parameter.
See Activate scenes parameter and Scenes parameter page.

The current status is allocated to the appropriate scene number when a scene is saved.
The previously saved status is restored when a scene number is called up.

This allows a MIX system to be easily associated with each chosen user scene.

Table 30: Permitted scene numbers

Series	Appliance	Supported scene numbers
MIX (order no. 4910xxx)	SME 2 S, JME 4 S, RME 4 S / C-load	1 .. 8
MIX2 (order no. 4930xxx)	RMG 4 I / RME 4 I, RMG 4 U / RME 4 U, RMG 8 S / RME 8 S, RMG 8 T / RME 8 T, DMG 2 T / DME 2 T, JMG 4 T / JME 4 T,	1 .. 64

The scenes are permanently stored and remain intact even after the application has been downloaded again.

See All channel scene statuses parameter on the Scenes parameter page.

8.1.2 Call up or save scenes:

To call up or save a scene, the relevant code is sent to the scene object (obj. 244).

Table 31

Scene	Call up		Save	
	Hex.	Dec.	Hex.	Dec.
1	\$00	0	\$80	128
2	\$01	1	\$81	129
3	\$02	2	\$82	130
4	\$03	3	\$83	131
5	\$04	4	\$84	132
6	\$05	5	\$85	133
7	\$06	6	\$86	134
8	\$07	7	\$87	135
9	\$08	8	\$88	136
10	\$09	9	\$89	137
11	\$0A	10	\$8A	138
12	\$0B	11	\$8B	139
13	\$0C	12	\$8C	140
14	\$0D	13	\$8D	141
15	\$0E	14	\$8E	142
16	\$0F	15	\$8F	143
17	\$10	16	\$90	144
18	\$11	17	\$91	145
19	\$12	18	\$92	146
20	\$13	19	\$93	147
21	\$14	20	\$94	148
22	\$15	21	\$95	149
23	\$16	22	\$96	150
24	\$17	23	\$97	151
25	\$18	24	\$98	152
26	\$19	25	\$99	153
27	\$1A	26	\$9A	154
28	\$1B	27	\$9B	155
29	\$1C	28	\$9C	156
30	\$1D	29	\$9D	157
31	\$1E	30	\$9E	158
32	\$1F	31	\$9F	159
33	\$20	32	\$A0	160
34	\$21	33	\$A1	161
35	\$22	34	\$A2	162
36	\$23	35	\$A3	163
37	\$24	36	\$A4	164
38	\$25	37	\$A5	165
39	\$26	38	\$A6	166
40	\$27	39	\$A7	167
41	\$28	40	\$A8	168
42	\$29	41	\$A9	169
43	\$2A	42	\$AA	170
44	\$2B	43	\$AB	171

Scene	Call up		Save	
	Hex.	Dec.	Hex.	Dec.
45	\$2C	44	\$AC	172
46	\$2D	45	\$AD	173
47	\$2E	46	\$AE	174
48	\$2F	47	\$AF	175
49	\$30	48	\$B0	176
50	\$31	49	\$B1	177
51	\$32	50	\$B2	178
52	\$33	51	\$B3	179
53	\$34	52	\$B4	180
54	\$35	53	\$B5	181
55	\$36	54	\$B6	182
56	\$37	55	\$B7	183
57	\$38	56	\$B8	184
58	\$39	57	\$B9	185
59	\$3A	58	\$BA	186
60	\$3B	59	\$BB	187
61	\$3C	60	\$BC	188
62	\$3D	61	\$BD	189
63	\$3E	62	\$BE	190
64	\$3F	63	\$BF	191

Examples (central or channel-related):

Calling status of scene 5:

Save current status with scene 5:

8.1.3 Teach in scenes without telegrams (MIX2 and FIX devices ONLY)

Instead of defining scenes individually by telegram, this can be done in advance in the ETS. This merely requires the setting of the *All channel scene statuses* (*Scenes* parameter page) to *Overwrite at download*.

Accordingly, the required status can be selected for each of the 8 possible scene numbers in a channel (= *Status after download* parameter).

The scenes are programmed into the device after the download has been completed.

Later changes via teach in telegrams are possible if required and they can be permitted or blocked via a parameter.

8.2 Conversion of percentages to hexadecimal and decimal values

Percentage value	0%	10%	20%	30%	40%	50%	60%	70%	80%	90%	100%
Hexadecimal	00	1a	33	4D	66	80	99	B3	CC	E6	FF
Decimal	00	26	51	77	102	128	153	179	204	230	255

All values from 00 to FF hex. (0 to 255 dec.) are valid.