

## **EN** Presence detector

theRonda S360-101 DE WH  
2080565

theRonda S360-101 DE GR  
2080566

theRonda S360-101 AP WH  
2080555

theRonda S360-101 AP GR  
2080556



## 1. Product characteristics 4


## 2. Safety 5

## 3. Proper use 5

## 4. Operation 6

Function description 6

Channel A light  7

Channel H presence  7

## 5. Detection area 8

Brightness measurement 9



## **6. Installation 11**

Ceiling installation - surface mounted 12

## **7. Switching 13**

Individual switching 13

## **8. Settings 13**

Parameters via remote control 14

Control commands via remote control 15

Brightness switching value Channel A light 15

Time delay Channel A light 16

Channel H presence time delay 17

Switch-on delay channel H presence 17

Detection sensitivity 17

Group address Channel A light	18
LED display motion	18
Factory settings	19
<b>9. Start-up</b>	<b>19</b>
Switch-on behaviour	19
Test detection area	20
<b>10. Technical Data</b>	<b>21</b>
Product overview	22
Troubleshooting	23
LED display	23
Guarantee	24
Dimensions diagrams	25
<b>11. Accessories</b>	<b>27</b>
<b>12. Contact</b>	<b>29</b>



# 1. Product characteristics

- Passive infrared presence detector for ceiling installation
- Circular detection area 360°, up to Ø 9 m (64 m<sup>2</sup>)
- Automatic presence- and brightness-dependent control for lighting and HVAC
- Mixed light measurement suitable for fluorescent lamps (FL/PL/ESL), halogen/incandescent lamps and LEDs
- Channel A light: relay, 230 V
- Operation as fully automatic device
- Brightness switching value configurable, teach-in function
- Pulse function for staircase light timer switch
- Channel H, presence: relay, floating e.g. for HVAC control
- Switch-on delay and time delay configurable
- Detection sensitivity configurable
- Ready for immediate use due to factory presetting
- Test mode for checking function and detection area
- Installation in false ceilings with springs, type DE
- Ceiling installation surface mounted, type AP
- User remote control "theSenda S" (optional)
- Management remote control "SendoPro" (optional)
- Service remote control "theSendaP" (optional)



## 2. Safety



**WARNING**

**Danger of death through electric shock or fire!**

- Installation should only be carried out by a qualified electrician!

- Work on electrical systems may only be carried out by qualified electricians or by instructed persons under the guidance and supervision of a qualified electrician in accordance with the technical regulations applying to electricity!
- Comply with the country-specific safety regulations for work on electrical systems! Ensure absence of voltage in the cable before installation!
- The device is maintenance-free. If the device is opened or penetrated with any object, the guarantee lapses.

## 3. Proper use

The presence detector is intended for indoor installation. The presence detector is exclusively intended for the use as contractually agreed between the manufacturer and the user. Any other use is


considered to be unacceptable. The manufacturer does not accept liability for any resulting damages.

## 4. Operation

The presence detector is primarily used in passageways such as corridors, stairs, toilets, basements and garages as well as in homes for easy and energy-efficient control of lighting plus HVAC. The switch contact "light" switches lighting on with presence and insufficient brightness, and off with absence or sufficient brightness.

The "Presence" switch contact controls heating, ventilation and air conditioning systems. The contact closes when someone is present, a switch-on delay permits delayed switch on.

### Function description

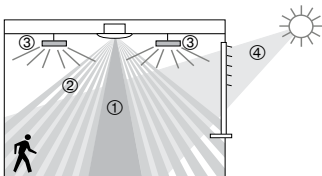

- ① Mixed light measurement
- ② Presence detection
- ③ Artificial light
- ④ Incident daylight

## Channel A light

Switching response is controlled by presence and brightness. The switch contact for Channel A light closes during darkness and when someone is present. It opens with a delay when there is brightness or once the room is vacated after the set time delay.

### Time delay

The time delay enables delayed switching off of lighting after the room is vacated. The time delay is adjustable in a range of 10s to 60min.

### Fully automatic device

Lighting control of the presence detector operates fully automatically for increased comfort. The lighting switches on and off automatically as a "fully automatic device".

### Pulse function

Time delay can be set to pulse for controlling existing staircase light timer switches. To do so, the light output produces a pulse of 0.5s in duration every 10 seconds if people are present or it is dark.

## Channel H presence

Channel H presence is used for HVAC control. The switching response of the floating contact is influenced only by presence and not by brightness. If



the contact is closed, the time delay will be restarted at every movement.

### **Switch-on delay**

The switch-on delay prevents instantaneous switching on. The contact closes only on expiry of the switch-on delay, provided that people are permanently present.

### **Time delay**

The time delay enables delayed switching off of HVAC devices and systems after the room is vacated. The time delay is adjustable in a range of 10s to 120min.




## **5. Detection area**

The circular detection area of the Ronda S presence detector covers an average detection area. Note that seated persons are detected in different sized areas. The recommended installation height is 2 m – 4 m. As installation height increases, the sensitivity of the presence detector decreases. The extent and distance between the active and passive zones of the presence detector also increases. The detection range is reduced as the temperature increases.



## Seated people

The presence detector reacts very sensitively to the slightest movements. The details refer to smallest movements at table height (approx. 0.80 m). The detection sensitivity is reduced from an installation height of > 3 m. More pronounced movements are required for clear detection.

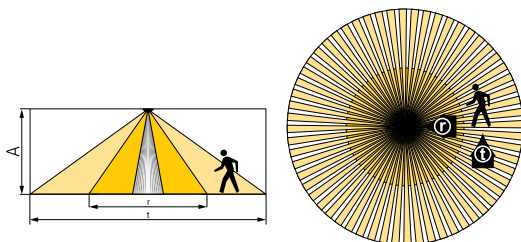

Installation height (A)	Across (t)	Frontal (r)	Seated (s)
2.0m	Ø 7.0m (38m <sup>2</sup> )	Ø 2.5m (5m <sup>2</sup> )	Ø 2.5m (5m <sup>2</sup> )
2.5m	Ø 7.0m (38m <sup>2</sup> )	Ø 3.0m (7m <sup>2</sup> )	Ø 3.0m (7m <sup>2</sup> )
3.0m	Ø 8.0m (50m <sup>2</sup> )	Ø 4.0m (13m <sup>2</sup> )	Ø 4.0m (13m <sup>2</sup> )
3.5m	Ø 8.0m (50m <sup>2</sup> )	Ø 4.0m (13m <sup>2</sup> )	–
4.0m	Ø 9.0m (64m <sup>2</sup> )	Ø 4.0m (13m <sup>2</sup> )	–

All figures are guidance values.


## Brightness measurement

The presence detector measures artificial light and daylight that is reflected below the detector (opening angle approx. 120°). The installation location is

the reference point for the lighting level. Direct light influences the light measurement.

- Avoid placing floor lamps or suspended lighting directly below the detector.

If the brightness measurement is deactivated, the channel A light only switches depending on the presence (brightness switching value set to "measurement off" via the remote control).

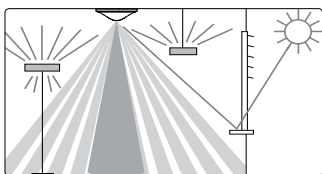


## Suitable lamps

The presence detector is designed for the operation of fluorescent lamps, compact fluorescent lamps, halogen/incandescent lamps and LEDs. The maximum number of switchable lights is restricted due to the high inrush current levels of the EBs and LED drivers. The use of an external contactor helps with large loads. All switched loads must be properly suppressed.

## 6. Installation


### Ceiling installation

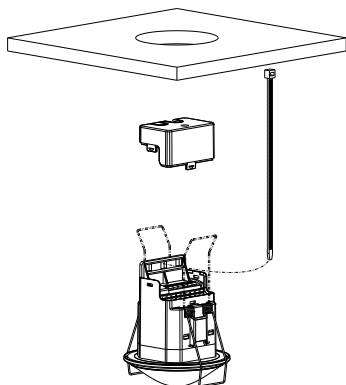

Installation in false ceilings for ceiling thicknesses of 0.5mm to 3cm. The diameter of the ceiling cutout must be between 62mm and 70mm. The cable strain relief is implemented using a cable tie (width: 3.5 – 4.8mm).

The detector requires a clear line of sight to people. The installation height must not be below 1.7m and not higher than 4m.

## Ceiling installation - surface mounted

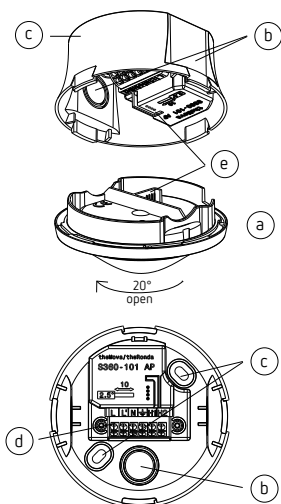


- ▶ Turn the sensor unit (a) by about 20° counter-clockwise, up to the snap-in point.
- ▶ Remove the sensor unit.
- ▶ Break out the required cable passages (b).
- ▶ Mount the power supply unit (c) on the ceiling using the provided fastening holes (c).
- ▶ Wiring in accordance with the label on the plug-in terminal, cable cross section 0.25 – 2.5mm<sup>2</sup> (d)
- ▶ Affix the sensor unit (a) paying attention to the plug-in connection (e).

## 7. Switching

The presence detectors can be operated as a Master in individual switching. With parallel switching of the light outputs (L'), it must be ensured that all detectors connected in parallel are connected to the same phase.

### Individual switching

In individual switching, the presence detector, as Master, detects presence and brightness and controls lighting.



## 8. Settings

The presence detector theRonda S does not have a potentiometer. The presence detectors are supplied with basic settings ready for operation. The specifications are guidance values. The service remote control "theSendap" or the management remote

control "SendoPro 868-A" are available as an option for start-up. They enable remote setting of all required settings.

## Parameters via remote control

The following parameters can be queried or changed via the remote control for support during installation as well as servicing:

Parameters	Description	Can be queried SendoPro 868-A	Can be changed SendoPro 868-A	Can be changed theSendo P
Brightness switching value Channel A light	Value range in lux	x	x	x
	Measurement off	x	x	x
Brightness actual value Channel A light	Value range in lux	x		
Time delay Channel A light	Value ranges in seconds/minutes		x	x
	Pulse		x	x
Channel H presence time delay	Value ranges in seconds/minutes		x	x
Switch-on delay H	Value ranges in seconds/minutes		x	
Detection sensitivity (PIR)	Value range in increments		x	x
Group address Channel A light	All / I / II / III		x	
LED display motion	Off/On		x	

The parameters are sent to the presence detector with the "SendoPro 868-A" management remote control or with "theSendo P" installation remote

control via infra-red. Changed parameters are immediately applied and used by the detector.

With the "SendoPro 868-A" management remote control, parameters can be queried by sending values level-by-level to the detector. If the sent value is below the set parameter, the LED illuminates briefly. If the sent value is equal to or above the set parameter, the LED flickers for 2 seconds.

## Control commands via remote control

Control command	Description	Can be triggered SendoPro 868-A	Can be triggered theSenda P
Teach-in Channel A light	The currently measured brightness value will be accepted as the brightness switching value. Values outside the permitted range will automatically be set to the appropriate limit value.	x	x
Switching light	Lighting group can be switched on and off.	x	x
Presence test	On/Off	x	x
Restart	Restart detector	x	x
Factory settings	Set all parameters and settings to factory setting.	x	

### Brightness switching value Channel A light

The brightness switching value defines the minimum desired brightness. The currently prevailing

brightness is measured below the presence detector. If the prevailing brightness is below the switching value, the light switches on as soon as a presence is detected.

## Value range

Lux values with "SendoPro 868-A" management remote control	30–3000 lux
The "theSenda P" installation remote control offers the following values	30, 300, 500, 800 lux

(The currently measured brightness value (lux) can be adopted with the "SendoPro 868-A" management remote control, with the teach-in control command or with the "theSenda P" installation remote control via the teach-in button.)

Values outside the permitted range will automatically be set to the appropriate limit value.

- Deactivating the brightness measurement (the brightness has no influence)

- Channel A lighting always switches with presence/absence.


"SendoPro 868-A" Management remote control, "theSenda P" installation remote control	Measurement off Button ☀
--	-----------------------------

## Time delay Channel A light

### Value range

Adjustable values with "SendoPro 868-A" management remote control	10s - 60min
In the "theSenda P" installation remote control, the following values are available	10s, 30s, 60s, 2min, 10min, 20min, 60min

Control for staircase light timer switch (0.5s "on" / 10s "off")

"SendoPro 868-A" "theSenda P"	Pulse Button  1
----------------------------------	---



## Channel H presence time delay

The presence channel switches on the basis of the presence (without brightness as a factor). The relay contact opens once the room is vacated after the set time delay expires.

### Value range

Adjustable values "SendoPro 868-A"	10s – 120min
Adjustable values "theSenda P"	10s, 30s, 60s, 2min, 10min, 20min, 120min



## Switch-on delay channel H presence

The relay contact only closes when someone is present after expiry of the set switch-on delay.

### Value range (only with management remote control "SendoPro 868-A")

Adjustable values	0s, 30s, 1 – 10min
No switch-on delay (relay contact closes immediately when someone is present)	0s

## Detection sensitivity

The detector has 5 sensitivity increments. The basic setting is the middle increment (3).

By selecting the test presence operating mode, the set sensitivity increment is not changed.

Increments 1 to 5 can be selected and sent to the detector with the "SendoPro 868-A" management remote control.

On the "theSenda P" installation remote control, the sensitivity can be increased or decreased by one increment each time the button is pushed.

Increment	Sensitivity
1	very insensitive
2	insensitive
3	Standard
4	sensitive
5	very sensitive



## Group address Channel A light

This parameter is applied when using the "theSenda S" user remote control. A group address can be assigned to Channel A light.

The "SendoPro 868-A" or "theSenda S" can be used to program the group addresses in the detector.

### Group address value range

Adjustable values "SendoPro 868-A"	I, II, III, All
Adjustable values "theSenda S"	I, II

## LED display motion

The motion detection can be displayed via the LED.

## Value range (only with management remote control "SendoPro 868-A")

No display of motion detection.	Off
The LED is switched on when motion is detected, otherwise switched off.	On

## Factory settings

The theRonda S360-101 presence detector is supplied with the following parameter values:

Parameters	Value
Brightness switching value Channel A light	300 lux
Time delay Channel A light	10min
Channel H presence time delay	10min
Presence switch-on delay H	0s
Detection sensitivity (PIR)	Increment 3
Group address Channel A light	I
LED display motion	Off

## 9. Start-up

### Switch-on behaviour

Every time the power supply is switched on, the presence detector first runs through a start-up phase of 30s, and then switches to normal operation. An LED displays the current status:



## 1. Start-up phase (30s)

- The red LED flashes at one second intervals, both switch contacts are closed (light and presence on).
- The detector does not react to remote control commands.
- When no one is present, both contacts open after 30s.

## 2. Operation

The detector is ready for operation (LED off).

### Test detection area

The test mode detection area is used to test presence detection and wiring. Presence test mode can be activated with the "SendoPro 868-A" management remote control and with the "theSenda P" installation remote control.





### Setting test mode detection area with remote control

- The detector goes directly into test mode when the test mode is set via the remote control:
  - Every movement is indicated by the LED.
  - When movement occurs, the light and presence switch contacts close.
  - When no one is present, the light switch contact opens after 10 seconds.

- Brightness measurement deactivated, detector does not react to brightness.
- Teach-in cannot be activated in test mode.
- Test mode ends automatically after 10min. The detector restarts itself (see switch-on behaviour).

## 10. Technical Data



Operating voltage	230V AC +/- 10%	
Frequency	50Hz	
Upstream protection device:	13A	
Power consumption	approx. 0.5W	
Type of installation	Ceiling installation	
Recommended installation height	2,0 – 3,0 m/max. 4 m	
Minimum height	> 1.7m	
Detection area	horizontal	360°
	vertical	120°
Maximum range	Ø 4m (Mh. 3m) / 13m <sup>2</sup> seated Ø 4m (Mh. 3m) / 13m <sup>2</sup> radially moving Ø 8m (Mh. 3m) / 50m <sup>2</sup> tangentially moving	
Setting range brightness switching value	30 – 3000 lux	
Lighting time delay A light	10s – 60min/pulse	
Channel H presence time delay	10s – 120min	
Channel A light	Relay 230V / 10A, $\mu$ -contact	
Max. switching capacity $\cos \varphi$ 1 resistive	2300W 	
Max. switching capacity $\cos \varphi$ 0.5	1150VA   	



Max. switching capacity LED	see manufacturer concerning $\cos \varphi$
Guide values	
LED lamps < 2 W	25 W
LED lamps $\geq$ 2 W	70 W
Guidance value max. inrush current level	400A / 200 $\mu$ s
Maximum number EBs T5/T8	10 x 54/58W, 16 x 35/36W 5 x 2 x 54/58W 8 x 2 x 35/36W
Channel H, presence	Relay, floating, base insulation
Maximum voltage	220V DC / 250V AC
Maximum switching capacity	50W / 50VA (max. 2A)
Recommended minimum load	0.5mV / 10mA
Connection type	Plug-in terminals
Max. cable cross-section	max. 2.5mm <sup>2</sup>
Protection rating: theRonda S360-101 DE	IP 20 IP 54 in installed state
Protection rating: theRonda S360-101 AP	IP 54
Ambient temperature	-15°C to +50°C
CE Declaration of Conformity	This device conforms to the safety regulations of the EMC directive 2014/30/EC and of directive 2014/35/EC.

## Product overview

Type of installation	Channel	Operating voltage	Colour	Type	Item number
Ceiling installation	Light   HVAC	230V AC	White	theRonda S360 -101 DE WH	2080565
Ceiling installation	Light   HVAC	230V AC	Grey	theRonda S360 -101 DE GR	2080566
Ceiling installation	Light   HVAC	230V AC	Special colour in accordance with customer information	theRonda S360 -101 DE SF	2080568

Ceiling installation	Light   HVAC	230V AC	White	theRonda S360--101 AP WH	2080555
Ceiling installation	Light   HVAC	230V AC	Grey	theRonda S360 -101 AP GR	2080556
Ceiling installation	Light   HVAC	230V AC	Special colour in accordance with customer information	theRonda S360 -101 AP SF	2080558

## Troubleshooting



Fault	Cause
Light does not switch on if presence is detected and in darkness	Lux value is set too low; light was switched off via theSenda S; person not within detection area; obstruction(s) interrupting detection; time delay set too short
Light does not switch off and/or light switches on spontaneously when no one is present	Wait for time delay; thermal sources of interference in the detection area: fan heaters, incandescent lamps/halogen spotlights, moving objects (e.g. curtains hanging in open windows); Load (EBs, relays) not cleared
Error flashing (4 x per second)	Error in self-test; Device not properly functional!

## LED display

LED	Description
Flashing at 1 second intervals	The presence detector is in the start-up phase.
Flickering for 2s	The command sent from the remote control via infrared was accepted by the presence detector.

LED	Description
Lighting up briefly	The command sent from the remote control via infrared was rejected by the presence detector. The command is not valid. Check the detector type or parameter selected in the "SendoPro".
Fast flashing	Error flashing; The presence detector has found an error.
Lights up or flickers irregularly	The presence detector is in detection area test mode or "LED display movement" is activated. The LED displays detection of movement.

## Guarantee

Theben HTS presence detectors are manufactured with the utmost care using state-of-the-art technology and are quality-tested. Theben HTS AG therefore guarantees perfect operation when used correctly. Should a fault occur, Theben HTS AG will fulfil the guarantee within the scope of the general terms and conditions.

Please note in particular:

- that the guarantee period lasts 24 months from the date of manufacture.
- that the guarantee is invalidated if you, or a third party, make changes to or undertake repairs on the devices.
- that, insofar as the presence detectors are connected to a software-controlled system, the guarantee for this connection is only valid when the indicated interface specification is complied with.





We undertake to repair or replace as quickly as possible all components of the delivered device that have become defective or unusable through demonstrably poor material, faulty construction or incomplete delivery up to the end of the guarantee period.

## Returns



In the event of a guarantee claim, please return the device to the relevant dealer together with the delivery note and a brief description of the fault.

## Industrial property rights


The design as well as hardware and software of these devices are protected by copyright.

## Dimensions diagrams

### theRonda S360-101 DE

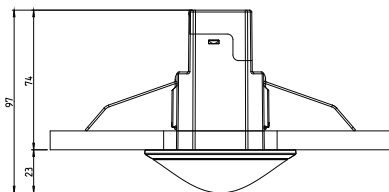

# theRonda S360-101 AP

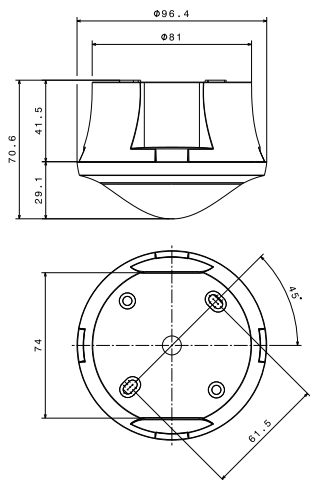

## 11. Accessories

SendoPro 868-A

Item No.: 9070675

Details > [www.theben.de](http://www.theben.de)



theSenda S

Item No.: 9070911

Details > [www.theben.de](http://www.theben.de)



theSenda P

Item no.: 9070910

[Details > www.theben.de](http://www.theben.de)



## 12. Contact

### **Theben HTS AG**

Im Langhag 7b

8307 Effretikon

SWITZERLAND

Phone +41 52 355 17 00

Fax +41 52 355 17 01

Hotline

Phone +41 52 355 17 27

support@theben-hts.ch

www.theben-hts.ch

### **All countries except Switzerland**

#### **Theben AG**

Hohenbergstraße 32

72401 Haigerloch

GERMANY

Phone: +49 7474 692-0

Fax: +49 7474 692-150

Hotline

Phone: +49 7474 692-369

hotline@theben.de

www.theben.de

